


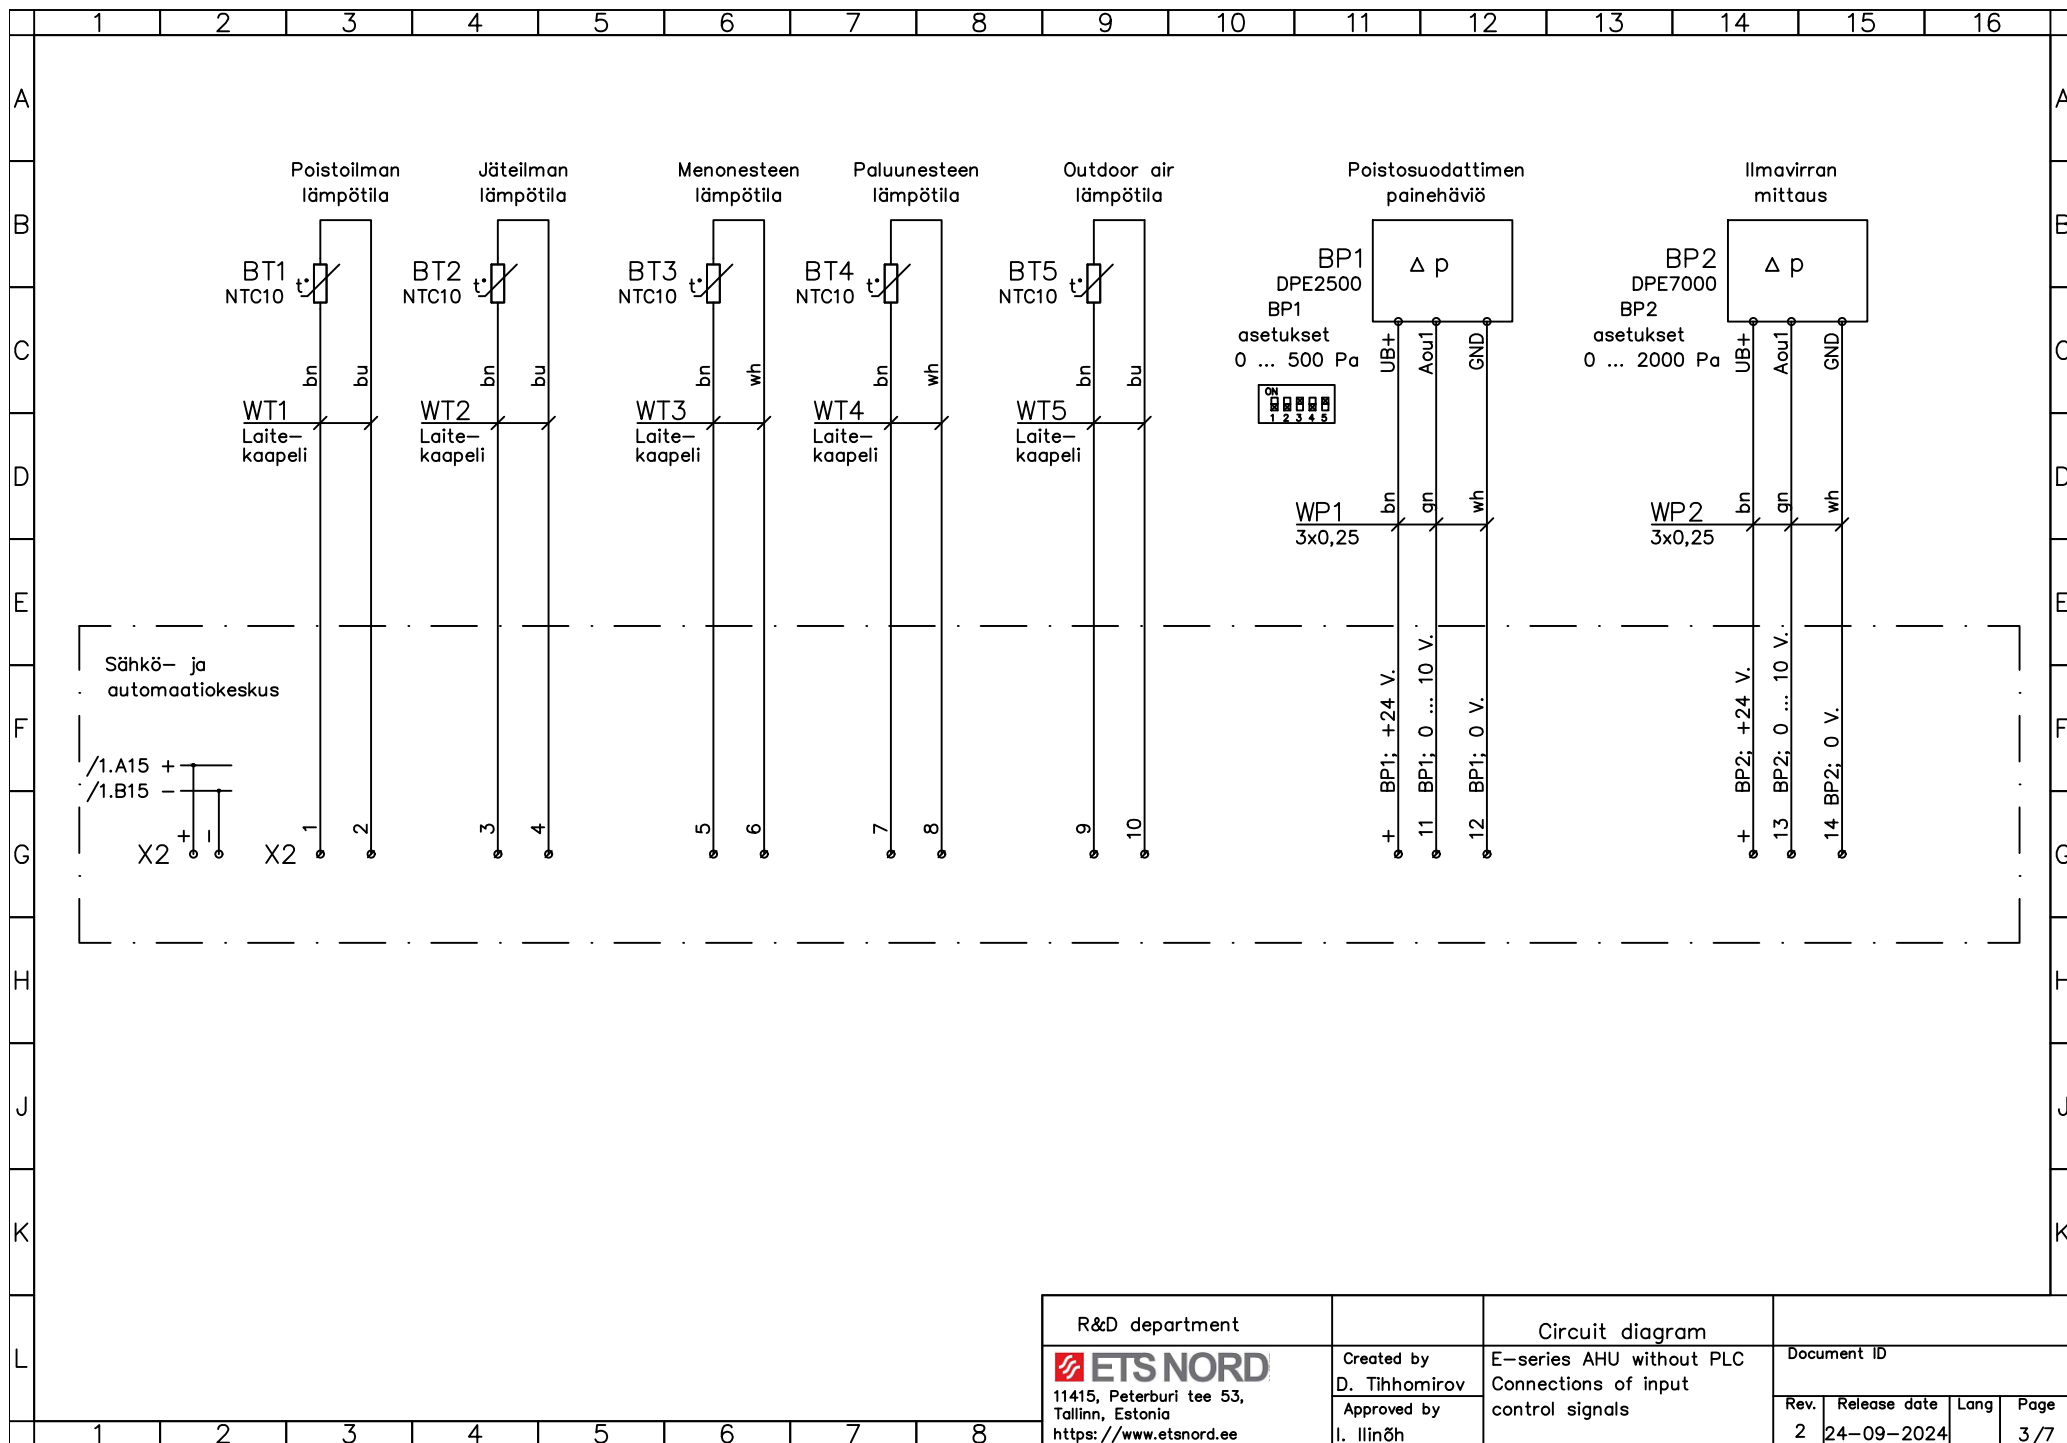
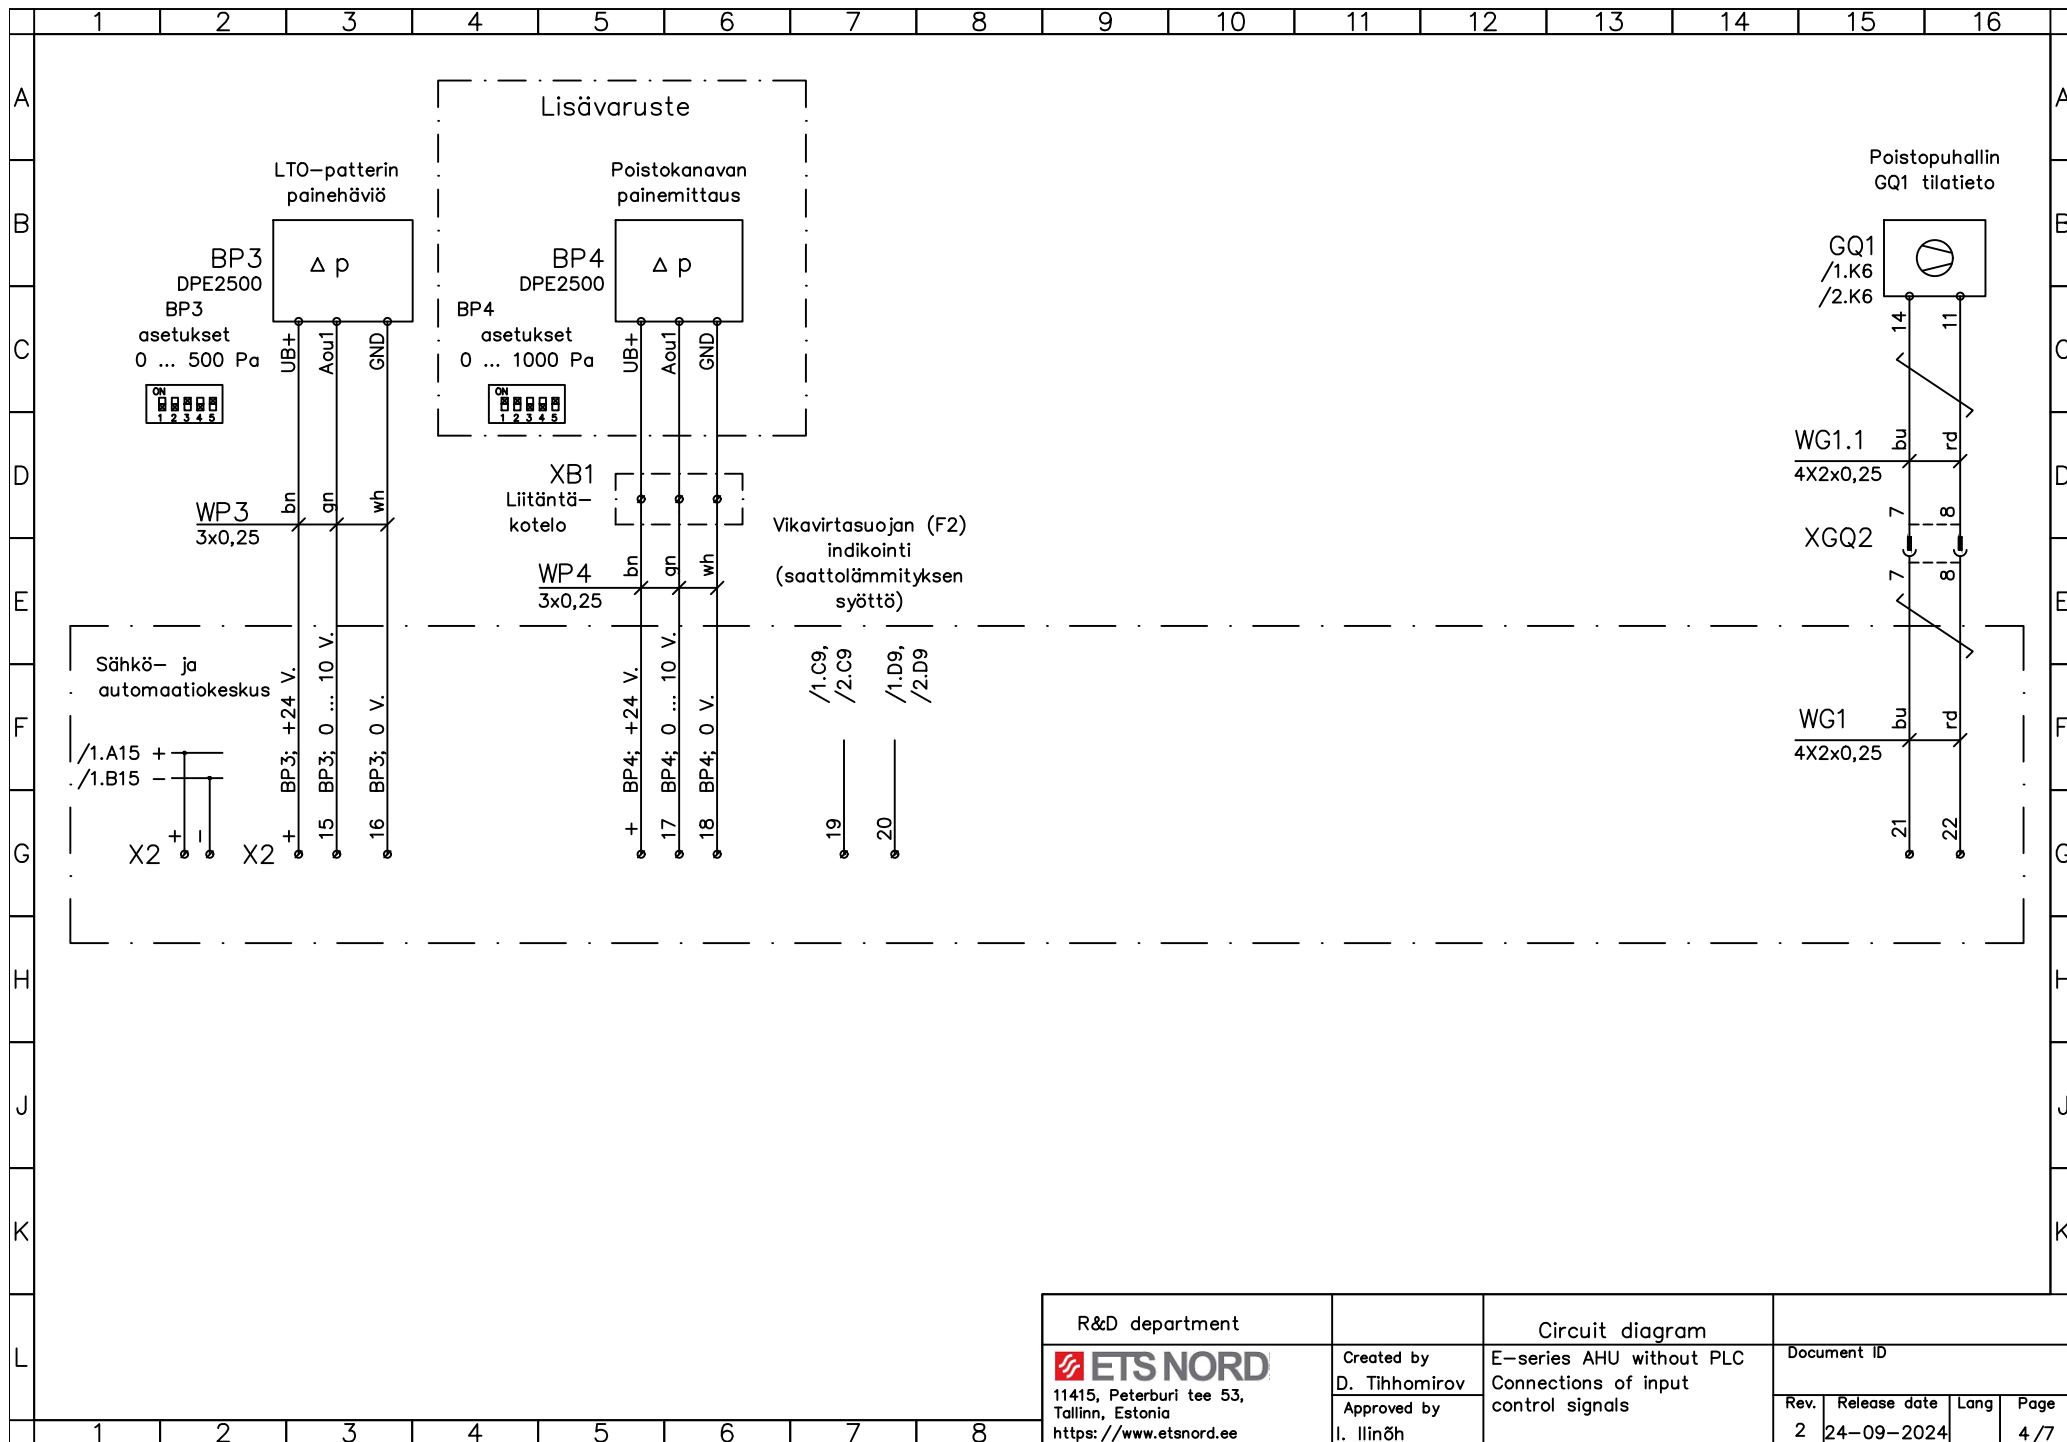





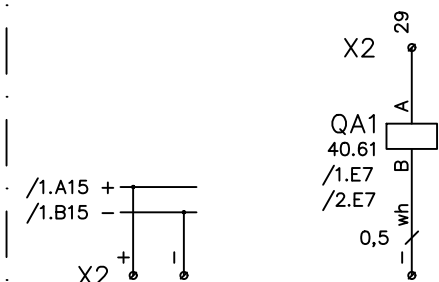

R&D department		Circuit diagram		Document ID	
 11415, Peterburi tee 53, Tallinn, Estonia https://www.etsnord.ee	Created by D. Tihomirov	E-series AHU without PLC Connections of input control signals		Rev.	Release date
	Approved by I. Ilinõh			2	24-09-2024
				Lang	Page
					4 / 7



Viemärin
saattolämmitys-
kaapelin ohjaus

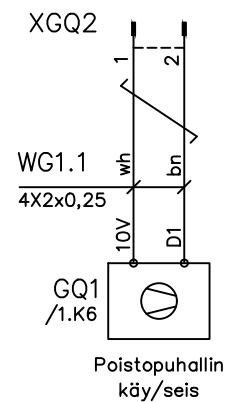

Or

